
Marco Dissolved Oxygen (DO) Status SEP-21

Source: City of Marco Island, Water Quality Sampling Reports

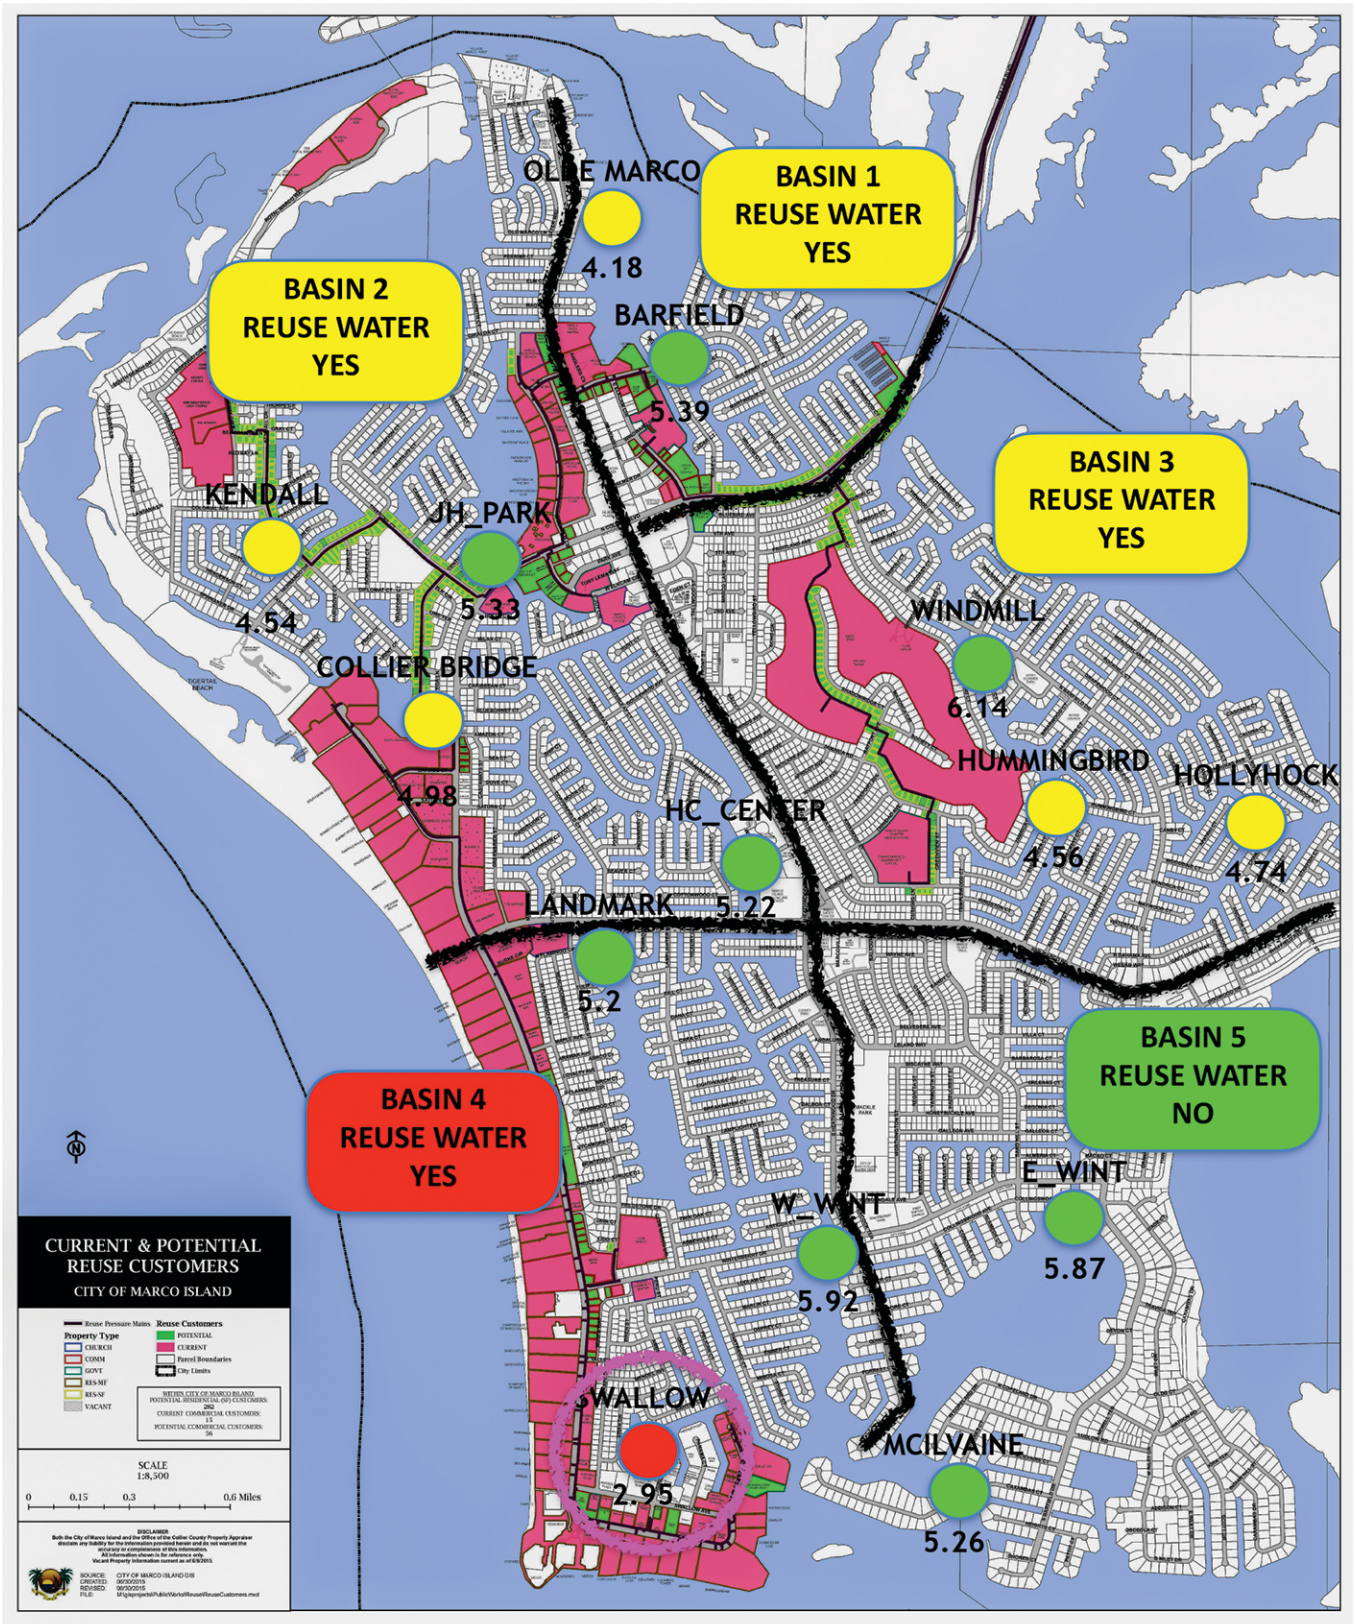

HYPOXIC < 3 mg/L

DEFICIENT < 5 mg/L

HEALTHY > 5 mg/L

6 locations deficient in oxygen; 1 Hypoxic